



# Overview of Asset Risk Cost Methodology

May 2019

## I. Overview of Risk Cost

### I.1 Introduction

This document outlines the methodology that Powerlink uses for quantifying risk associated with network assets approaching the end of their technical and economic life.

This methodology is used within the quantification of risk cost that Powerlink undertakes as part of the economic assessment within Regulatory Investment Test for Transmission (RIT-T) consultations. Risk cost is one input into the RIT-T economic assessment. There are also other costs and benefits that are incorporated within the financial analysis.

The methodology is based on the “Cumulative Act Model” or “Swiss Cheese Model” shown in Figure 1. The model is conceptualised by the presence of layers within a system that need to fail for the risk event to occur.

This building block methodology provides a modular approach to evaluating risk, and allows better understanding of contributing factors that can lead to the risk event. This enables risk to be quantified in a more structured, consistent and transparent manner.

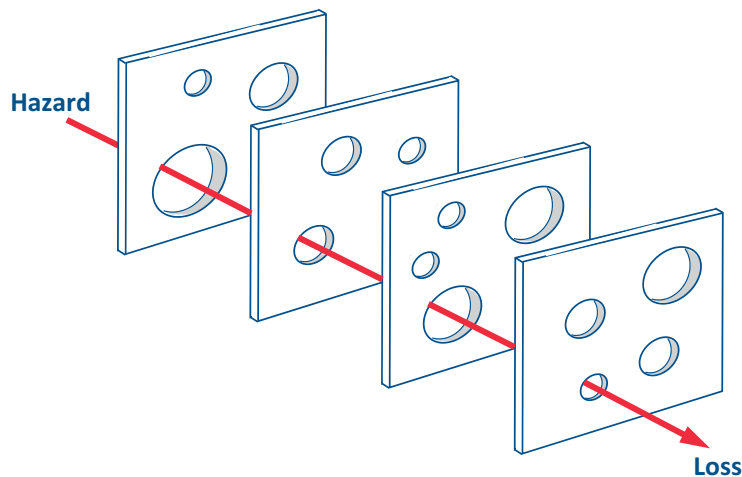


Figure 1 Cumulative Act Model (“Swiss Cheese Model”)

### I.2 Risk Cost Definition

The risk cost provides a measure of the expected financial (or monetised) value of the risk event.

The risk cost is defined as the probability weighted cost of consequence as shown below. The likelihood of consequence factors represent the moderating factors for the consequence occurring.



Figure 2 Risk Cost Definition

Risk cost needs to be defined over a period of time. For asset planning purposes, risk cost is usually assessed on an annual basis.

### 1.3 Risk Cost Calculations

The risk cost for network assets approaching end of life is calculated for each failure type and consequence category. The consequences and moderating factors can vary for different failure modes and risk categories. Hence the risk cost needs to be built up from a series of individual calculations.

Each calculation maps the failure mode to the consequence and corresponding moderating factors.

Powerlink examines risk cost across four broad categories of consequences – safety, network, financial and environmental. Each category of risk may involve a number of consequences and moderating factors.

The calculation of risk cost across the four risk categories for a particular failure type is shown in Figure 3.

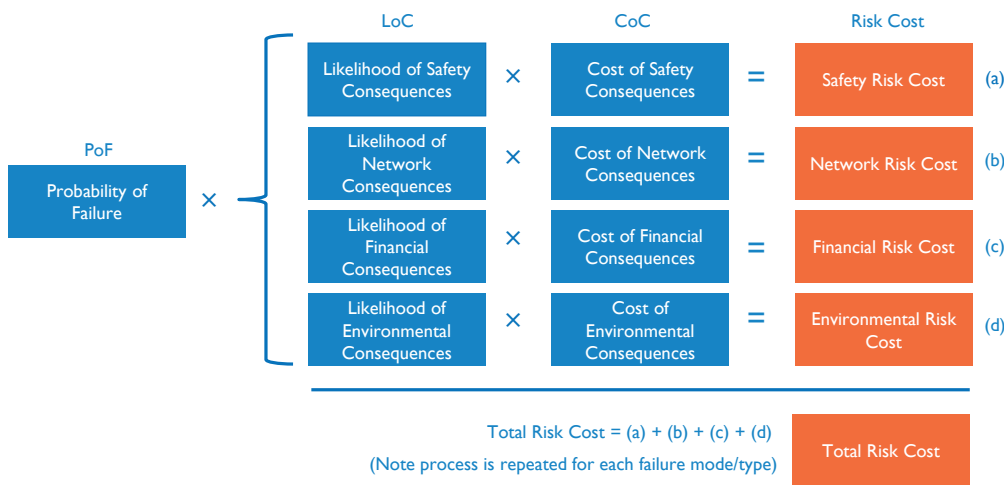


Figure 3 Risk Cost Calculation Building Blocks

### 1.4 Cumulative Risk Cost

The risk cost approach can be used to determine cumulative risk levels across a number of network assets.

Consider a system where there are two separate components, and the failure of each component occurs in an independent manner. The cumulative risk of the system is defined as:

$$\text{Cumulative Risk} = L1 \times C1 + L2 \times C2 + L1 \times L2 \times C3$$

where: L1 and L2 represent the likelihood of failure for components 1 and 2

C1 and C2 represent the consequences of failure for components 1 and 2


C3 represents the consequence of concurrent failures of components 1 and 2.

For low probability events, the third term may be ignored if the consequence associated with a concurrent failure of both components does not increase in the same proportion to the probability of the concurrent failure. Under these circumstances, the cumulative risk level can be approximated as follows:

$$\text{Cumulative Risk} = L1 \times C1 + L2 \times C2 + \dots + Ln \times Cn = \sum L \times C$$

The above is valid only where the failures are independent events and outcomes are comparable.

An example of risk cost calculated for a substation bay is shown in Figure 4. The risk cost is the summation of risk cost for each individual component of the bay. A similar approach can be used for other asset classes.

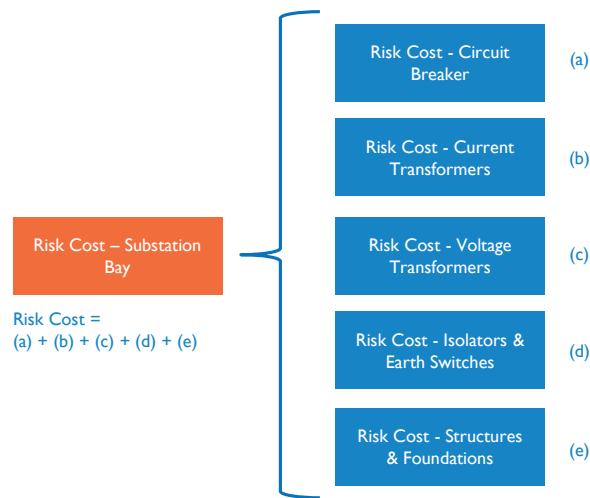

**Figure 4 Cumulative Asset Risk Cost (Substation Bay Example)**

Where the probability of concurrent failure can materially impact risk cost, reliability theory can be used to calculate cumulative risk.

For example, where there are a number of series components reaching end of life within a network element, reliability theory can be used to calculate the cumulative probability of failure. The risk cost is the product of the cumulative probability and network consequence, provided the consequence of failure and moderating factors are similar for each component.

This approach may be especially applicable when calculating the network risk cost for several items of equipment when failure of one or more elements leads to the same network consequence (eg. tower structures making up an overhead transmission line).

## 2. Risk Cost Methodology

### 2.1 Risk Scenario

The first step in assessing risk cost is defining the risk scenario. The risk scenario describes the risk event, and outlines the circumstances and chain of events that need to occur for the adverse impact to eventuate. This in turn provides context for the building block components that are required to quantify risk cost.

### 2.2 Probability of Failure (PoF)

#### 2.2.1 General


It is necessary to quantify the probability of asset failure. For asset planning purposes, asset failure is defined as irreparable failure that requires replacement for continued functionality. The probability of asset failure rates generally excludes repairable faults or non-critical functional failures.

Powerlink endeavours to derive failure curves that are functions of parameters that reflect actual asset condition. Whilst these models are more accurate, they are generally more complex than age based failure models, since the change in condition as a function of time also needs to be derived.

The failure curve needs to consider the particular failure mode of the asset. Where there are several failure modes, the risk cost for each mode of failure needs to be calculated.

#### 2.2.2 Failure Patterns

The failure patterns associated with each type of equipment item needs to be determined. The six standard types of failure patterns recognised within asset management are shown in Figure 5.

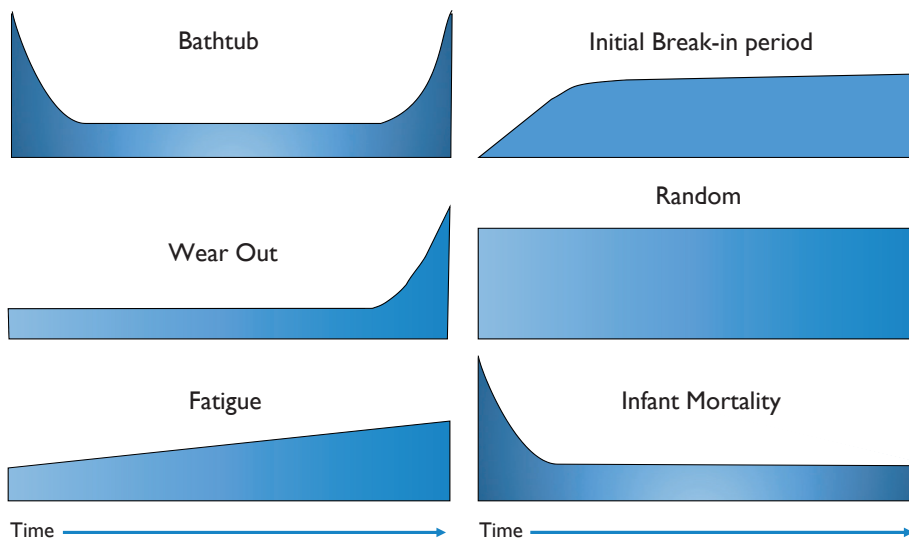

**Figure 5** Categories of Failure Patterns

Failures of high voltage primary plant (such as large power transformers) generally follow the characteristic bathtub failure pattern.

Overhead transmission line components and hardware generally follow the wear-out failure pattern. This pattern represents an increasing rate of failure towards the end of life as protective galvanising layers are depleted leading to metal loss with corresponding reduction in strength. The structural integrity may also degrade over time due to fatigue resulting from fluctuating stresses (eg. wind induced vibration).

Digital equipment and secondary system protection equipment generally follow a random failure pattern with some element of fatigue.

The ageing portion of the failure pattern is of most interest when quantifying risk cost associated with assets approaching end of life.

### 2.2.3 Derivation of Failure Curves

The methodology used for deriving failure curves will depend on a number of factors. Where there is a statistically valid population of equipment components within Powerlink's fleet and there are reliable historical failure records, failure curves can be derived from historical failure events.

Where there are insufficient records, data from reputable and independent external sources (eg EPRI or CIGRE) may be used.

Where failure curves are derived from Powerlink's historical failure events, these are compared against published information to verify the reasonableness of the data.

## 2.3 Likelihood of Consequence (LoC)

The likelihood of consequence represents the moderating factors associated with the consequence. These factors can vary depending on the nature of the failure, the context and location of the asset, and preventative barriers or controls to mitigate the risk. As an example, collapse of an overhead transmission structure will not necessarily result in loss of supply or an injury.

Powerlink bases calculation of the likelihood of consequence from various sources of information including internal records and public data. Where data is not available, it may be necessary to estimate the likelihood of consequence from engineering estimates and professional judgement.

The rigour involved with deriving the moderating factors is proportionate to the criticality of the input to the risk cost outcome. Where inputs materially impact the risk cost, additional rigour is generally warranted to validate the input. Conversely, where inputs do not have a material impact on the risk cost, high level estimates may be sufficient.

## 2.4 Cost of Consequence (CoC)

The risk cost approach requires an assessment of the financial equivalent of the risk consequence. For certain types of consequences, the monetised equivalent can be readily determined since this may be a direct financial cost. However, for other types of risk categories, it may be more difficult to place a monetary value on the consequence. For example, it may be difficult to determine the monetised equivalent of safety events since these may involve impacts which are subjective and intangible.

For these types of consequences, it is often useful to base costs using information published by independent and industry reputable sources. Many of these organisations have developed values based on research and surveys for a range of purposes including the formulation of government policy and regulation. In these instances, Powerlink makes use of these valuable references for risk cost calculations.

## 2.5 Assumptions on Controls

Standard controls and mitigation measures that are part of Powerlink's management systems (e.g. asset management systems, health and safety systems, and environment management systems) are taken into account when determining risk cost.

Example of controls include Powerlink's standard operating practices and procedures, protective equipment, and switching operations to transfer loads or reconfigure the network following network faults.

## 2.6 Calculation of Risk Cost

The risk cost is calculated for every material failure mode and category of risk. The risk cost for the asset is determined by adding the individual risk costs for each component across failure modes and risk categories.

Risk cost is generally expressed in real dollars.

## 2.7 Residual Risk

The residual risk is defined as the level of risk following implementation of the credible option or risk mitigation measure.

## 2.8 Risk Cost Benefit

The reduction in risk associated with a credible option is a benefit. This benefit can be quantified using risk cost as follows:

Risk Cost Benefit = Risk Cost Prior to Option – Residual Risk Cost

## 2.9 Extrapolation of Risk Cost

It may be sufficient to quantify projected risk costs over a ten year modelling horizon, since there are increasing levels of uncertainties in forecasting the deterioration of asset health and other variables beyond this period. However, since the financial analysis comparing options is often carried out across larger modelling periods, extrapolation of risk is required.

The risk cost benefits may be extrapolated beyond the detailed computational period using either linear or non-linear projection techniques.

## 2.10 Materiality of Inputs

It is important to identify the salient inputs that most impact on the calculation of risk cost.

An understanding of the materiality of inputs enables focus to be placed on data that makes the greatest impact on risk cost. This can assist in determining where additional rigour is required in collecting and deriving data, and validating assumptions.

## 2.11 Overlay of Market Benefits

The AER Regulatory Investment Test for Transmission (RIT-T) requires an assessment of market benefits where these may be material in the economic evaluation of credible options.

One class of market benefits relates to the reduction in unserved energy. This category of market benefit comprises of the reduction in involuntary load shedding resulting from implementation of a credible option. However the risk cost benefits associated with implementation of an option may also incorporate a reduction in the likelihood of unserved energy. Hence, the network risk cost benefit associated with an option may also include a component of market benefit.

It is important to ensure that the assessment of credible options do not double count market benefits and network risk cost benefits. For clarity, the market benefits associated with reduction in unserved energy will generally be considered as part of the network risk cost benefits within the financial analysis of options.

There may be other classes of market benefits which are not included as part of the network risk cost benefits. Examples of these include reduction in transmission losses, dispatch cost benefits, and reductions in voluntary load curtailment. These categories of market benefits will need to be quantified separately where they are material to the outcome of an economic assessment.

## 3. Assessment of Consequences

### 3.1 Categories of Consequences

Powerlink classes the consequence of asset failure into four broad categories – safety, network, financial and environmental. The consequences of failure for a particular asset and risk scenario are assessed on a case by case basis taking into account the type of asset, location of the asset, network connectivity, and operating and environmental conditions.

Examples of potential consequences that might arise through the failure of ageing network assets are shown below. These consequences include both internal and external facing impacts (e.g. end user customer impacts). Note this is not intended to be an exhaustive list of consequences that are considered.

#### *Safety*

- Potential safety impacts to field personnel working in the vicinity of electrical equipment with potential for explosive failure
- Potential safety impacts to members of the public due to failure of assets in publicly accessible places
- Safety consequences associated with car accidents caused by downed conductors or earthwires that traverse motorways.

#### *Network*

- Interruptions to supply as a result of plant failures and outages
- Tripping of adjacent items of plant when equipment fails in an explosive manner
- Extended outages of plant where emergency replacements or spare units are not readily available or take considerable time to install and commission
- De-energisation of a substation in an event of a fire arising from plant failure which may lead to supply interruptions.

#### *Financial*

- Replacement of a failed asset in an emergency manner
- Damage to adjacent items of plant in the event of explosive equipment failure or transformer fire
- Clean-up and remediation of oil and other contaminants
- Community engagement costs
- Property damage resulting from structure failures
- Costs associated with supply of diesel generators or other sources of supply during prolonged outages
- Delays to projects, rescheduling of planned works, and other business disruption costs.

#### *Environmental*

- Breach of oil outside the substation where containment measures fail
- Release of greenhouse gases (SF<sub>6</sub>) into the environment arising from equipment failures.

### 3.2 Sources of Data

Powerlink endeavours to base the cost of consequences using data from actual failure events or published by independent and reputable industry sources.

The basis for a selected set of consequences are shown in Table I below.



**Table I Sources of Consequence Data**

Risk Category	Consequence	Source	Input	Value
Safety	Safety impacts	Department of Prime Minister and Cabinet Office of Best Practice Regulation (OBPR)	Value of Statistical Life (VSL)	As per the OBPR Guidance Note (1)
Network	Loss of supply	Australian Energy Market Operator (AEMO)	Value of Customer Reliability (VCR) (2)	Dependent on customer group and mix
Financial	Damage to equipment and emergency restoration	Powerlink	Actual financial costs incurred by Powerlink based on historical events	Dependent on asset type and failure

Notes:

- (1) Refer Department of Prime Minister and Cabinet web-site: [https://www.pmc.gov.au/sites/default/files/publications/Value\\_of\\_Statistical\\_Life\\_guidance\\_note.pdf](https://www.pmc.gov.au/sites/default/files/publications/Value_of_Statistical_Life_guidance_note.pdf)
- (2) Refer AEMO web-site: <http://www.aemo.com.au/Electricity/National-Electricity-Market-NEM/Planning-and-forecasting/Value-of-Customer-Reliability-review>

### 3.3 Health and Safety

At Powerlink, the health and safety of our employees, contractors and the communities in which we operate is essential. Powerlink does not consider that a value can be placed on any human life. Powerlink is committed to the elimination of all work-related injury, illness, and environmental harm.

The National Electricity Amendments Rules on Replacement Expenditure Planning is supported by guidance developed by the Australian Energy Regulator through the Industry Practice Application Note on Asset Replacement Planning<sup>1</sup>. This document refers to the Value of Statistical Life (VSL) as a way of assisting in the calculation of risk cost.

For the purposes of achieving consistency in capital expenditure proposals with other network service providers, Powerlink uses the VSL model recommended by the AER. The use of VSL is for comparison of capital expenditure proposals alone and does not reflect the practice that Powerlink adopts to its risk assessments for the performance of work or detract from its commitment to eliminate all injury from its work.

### 3.4 SFAIRP

The Workplace Health and Safety Act requires that organisations are responsible for ensuring the health and safety so far as is reasonably practical (SFAIRP). The definition for what is reasonably practical extends to making an assessment whether costs to reduce risks are grossly disproportionate to the risk being mitigated.

There is no definitive point where the level of expenditure may be considered to be grossly disproportionate due to the absence of guidance information and legal precedents. However, standard rules have been generally accepted by regulators internationally for disproportionality which takes into account the nature of the risk and exposure to workers and the public.

Disproportionality factors represent the ratio of the cost of the risk mitigation to the benefits in mitigating the risk. These factors can assist in determining at which point an investment is considered to be grossly disproportionate to the risk being mitigated. This approach is supported by guidance contained within the AER Industry Practice Application Note on Asset Replacement Planning.

Powerlink uses this approach when assessing capital expenditure proposals within RIT-Ts and other asset planning activities. The disproportionality factors used are consistent with those adopted by other Australian and international utilities.

<sup>1</sup> Refer AER web-site <https://www.aer.gov.au/networks-pipelines/guidelines-schemes-models-reviews/industry-practice-application-note-for-asset-replacement-planning>

## 4. Risk Cost Considerations

The factors that impact risk cost vary considerably, and depend on the characteristics of the asset, design attributes, physical location, network connectivity, availability of spares, and other considerations. These are reflected collectively within the building block inputs that make up risk cost (ie PoF, LoC and CoC).

Examples of considerations that may impact risk cost are shown below.

**Table 2** Examples of Considerations that may Impact Risk Cost

Asset Class	Components	Attributes	Parameters	Impacts on Risk Cost
All Primary Plant	Lines, transformers, and substations plant	Asset Condition	PoF	The probability of failure may increase as the asset reaches end of life
Overhead Lines	Structures, insulators, earthwires, and other above surface components	Corrosion region	PoF	The condition of assets within high corrosion regions (such as coastal or tropical environments) will deteriorate faster than those in lower corrosion regions
		Proximity to public areas, roads and railways	LoC and CoC	Overhead lines traversing public areas and roads will have higher consequences under structure failure or conductor drop scenarios
Substations	Instrument transformers	Equipment casing and insulating medium	CoC	Older style instrument transformers with porcelain housings and oil insulation can have higher safety, financial and network consequences compared to newer designs
	Power transformers and circuit breakers	Availability of spares	CoC	The unavailability of spares can prolong equipment restoration times impacting network reliability and incurring higher financial costs
	Transformer bushings	Bushing types	CoC	Older style porcelain bushings can have higher safety, financial and network consequences compared to newer designs
Secondary Systems	Protection Relays and Remote Terminal Units	Manufacturers support and availability of spares	CoC	The unavailability of spares and manufacturers support can prolong restoration times impacting network reliability and incurring higher financial costs
All Classes	All Components	Network criticality	CoC	The more critical parts of the high voltage system will be impacted more in the event of equipment failures
		Ability for load transfers and embedded generation	CoC	The ability to transfer load across the downstream distribution network or dispatch of embedded generation can help mitigate the network impacts of equipment failures
		Customer type	CoC	Higher value customer loads will be impacted more from loss of supply events (reflected through VCR)
		Location of asset and proximity to transport infrastructure	CoC	Assets located in remote areas will have longer field response and restoration times compared to those located near major roads and regional depots
		Load pattern	LoC	Customer load patterns which are sharper (more peaks) may be impacted less by network outages compared to flatter load shapes
		Condition of adjacent equipment	LoC and CoC	The likelihood of concurrent failures and subsequent loss of load are higher where there are a number of aged plant items within the area

## 5. Conclusions

This document outlines an approach for quantifying the risk cost of network assets approaching the end of their technical and economic life.

The document outlines a methodology which enables key risks associated with end of life network assets to be quantified in a structured, transparent and consistent manner. The approach is used to provide input into the economic comparison of options within strategic asset planning and regulatory approval activities.

**Disclaimer:** This guide is provided for information purposes only. This means Powerlink does not warrant the accuracy or currency of the guide. The material is not provided for the recipient to rely on or act on, nor does it have any legal effect. The guide is subject to many assumptions, dependencies, contingencies and variables and Powerlink is under no obligation to inform the recipient if the guide changes or becomes inaccurate.



## Contact us

Registered office 33 Harold St Virginia  
Queensland 4014 Australia  
ABN 82 078 849 233

Postal address GPO Box 1193 Virginia  
Queensland 4014 Australia

Telephone (+617) 3860 2111  
(during business hours)

Website [www.powerlink.com.au](http://www.powerlink.com.au)

Social media    